




API PLAN - 32

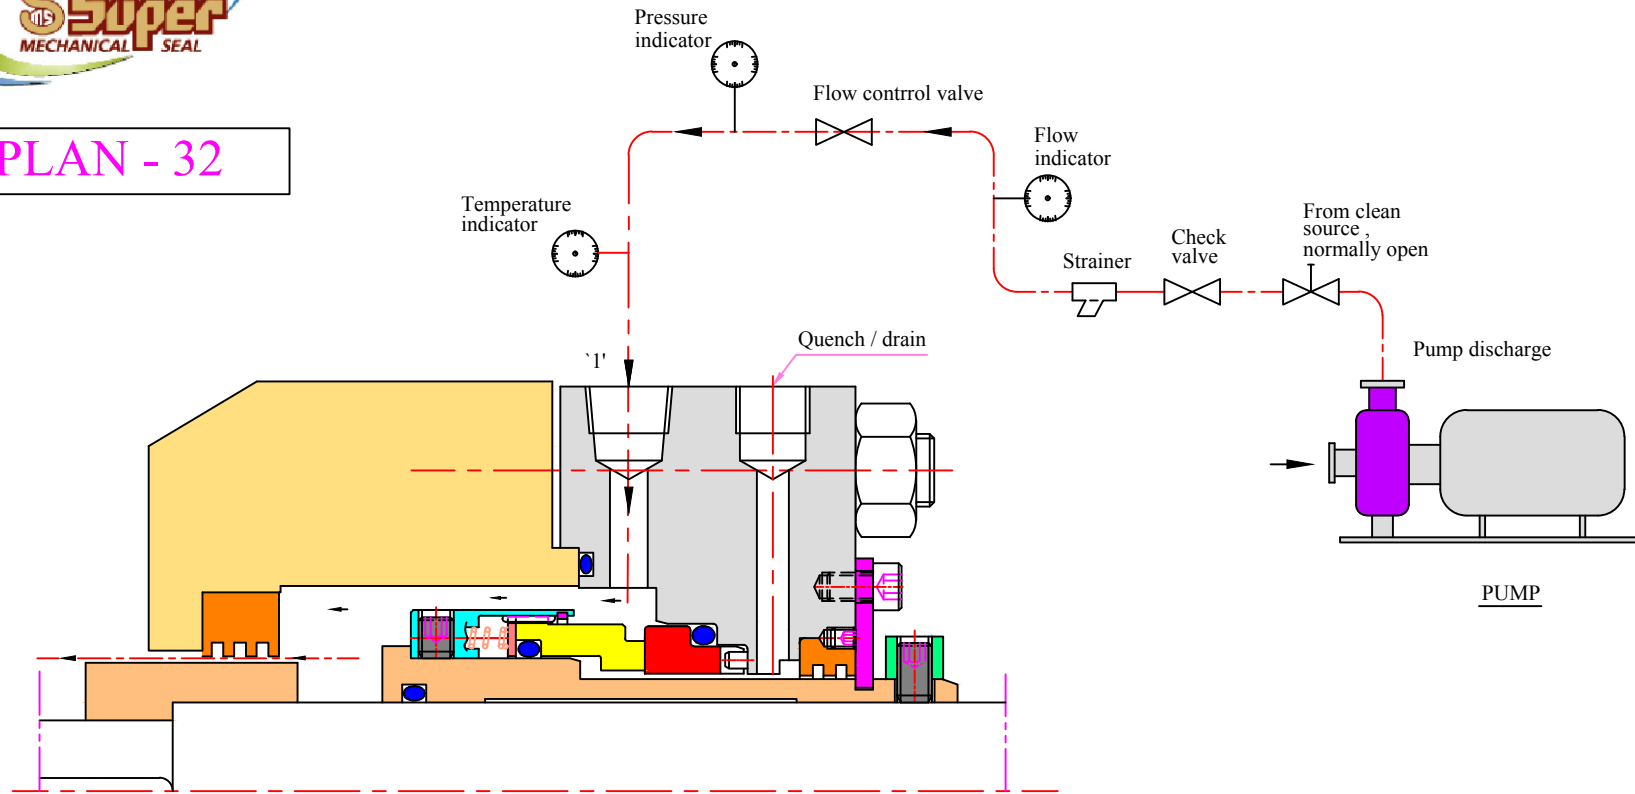

- Flush is injected into the seal chamber from an external source at higher pressure.
- Care must be exercised in choosing a proper source of seal flush to eliminate potential for vaporization of the injected fluid and to avoid contamination of the fluid being pumped with the injected flush.
- Connection `1' for flushing inlet.

- Dirty or contaminated fluids, paper pulp.
- High temperature service
- polymerizing and /or oxidizing fluids.